



A KELE COMPANY

www.Lesman.com • 800-953-7626 • sales@lesman.com

Instruments • Valves • Controls

516

V10.2022

Name: \_\_\_\_\_

Company: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_

When do you need a quote? \_\_\_\_\_

When do you need the equipment on site? \_\_\_\_\_

When will you place the order? \_\_\_\_\_

# GPI Flomec Application Datasheet



## Process Conditions

Fluid: \_\_\_\_\_

Viscosity: \_\_\_\_\_ @ \_\_\_\_\_ °F

Specific Gravity: \_\_\_\_\_ Density: \_\_\_\_\_

Particulate?  No  Yes Size: \_\_\_\_\_

% of Solids: \_\_\_\_\_ % of Air: \_\_\_\_\_

Air Elimination Required?  No  Yes

Pulsating Flow?  No  Yes

	Min.	Normal	Max.	Units
Flow Rate:	_____	_____	_____	<input type="checkbox"/> GPM <input type="checkbox"/> LPM
Temperature:	_____	_____	_____	<input type="checkbox"/> °F <input type="checkbox"/> °C
Pressure:	_____	_____	_____	<input type="checkbox"/> PSI <input type="checkbox"/> bar
Pressure Drop:			_____	<input type="checkbox"/> PSI <input type="checkbox"/> bar

## Process Pipe

Material: \_\_\_\_\_

Pipe O.D.: \_\_\_\_\_ Schedule: \_\_\_\_\_

Nominal Size: \_\_\_\_\_ Wall Thickness: \_\_\_\_\_

## Product Selection

Approved Wetted Materials: \_\_\_\_\_

Process Connection Type:  Thread  Flange  
 Tri-Clover  Spigot

Accuracy: \_\_\_\_\_ % of Reading Repeatability: \_\_\_\_\_

Power:  AC  DC  Battery


Approvals:  FM  UL  CSA  ATEX  3A

Do you need flow totalization?  No  Yes

Display:  None  Local  
 Remote

Output:  None  Pulse  
 Current

## Basic Application Sketch

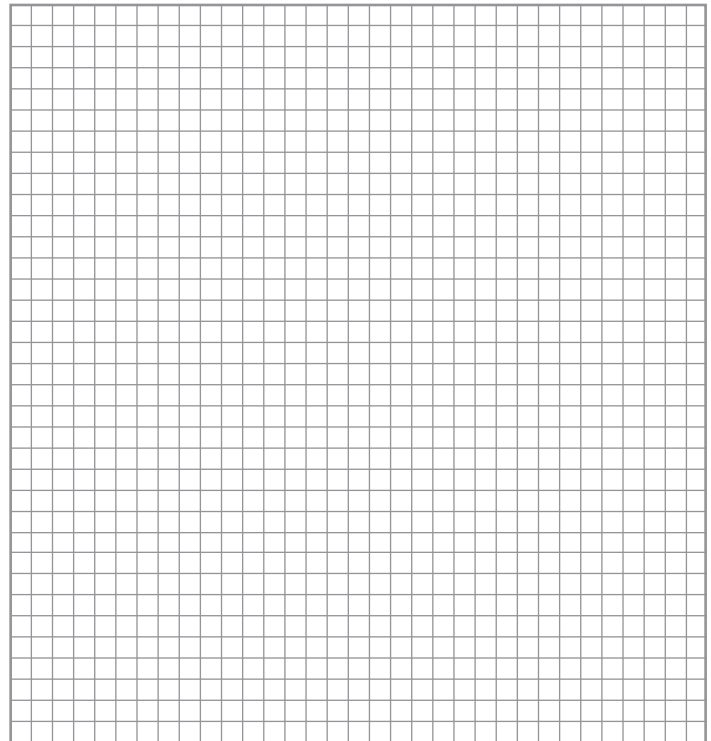

## Special Instructions/Notes: \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_